


VENT & OVERFLOW TABLE

SERVICE PIPE SIZE	MIN. DIMENSIONS	
	X	Y
3/4"	4"	3"
1"	4"	4 1/2"
1 1/2"	5"	6"
2"	6"	7"
3"	7"	10"
4"	7"	10"
6"	7"	15"

- NOTE:**
- (1) DESIGN, FABRICATION, INSTALLATION AND OPERATION MUST COMPLY WITH STANDARDS OF THE AMERICAN WATER WORKS ASSOCIATION (AWWA) AND ALL FEDERAL, STATE AND LOCAL LAWS, RULES, REGULATIONS, ORDERS, CODES AND ORDINANCES.
  - (2) THE AIR GAP SEPARATION SHALL BE INSTALLED SUBJECT TO THE APPROVAL OF CLWSC. ANY DEVIATION FROM THE METHODS DESCRIBED HEREON MUST RECEIVED APPROVAL PRIOR TO INSTALLATION.
  - (3) NO CONNECTIONS SHALL BE MADE BETWEEN METER AND CONSUMERS TANK.
  - (4) THE OVERFLOW OPENING AND SCREEN SIZE SHALL BE AS SHOWN HEREON OR OF GREATER CAPACITY AS REQUIRED TO MAINTAIN THE SPECIFIED AIR GAP SEPARATION.

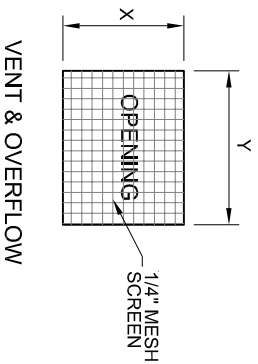

VENT & OVERFLOW

GENERAL NOTES:  
 (1) FOR ADDITIONAL INFORMATION, SEE CANYON LAKE WATER SERVICE COMPANY'S STANDARD SPECIFICATIONS.

BY	REVISION	DATE	CK	AP	OPS

**CLWSC**  
 CANYON LAKE  
 WATER SERVICE COMPANY  
 1399 Sattler Road  
 Canyon Lake, Texas 78133  
 (830) 964-3854

**AIR GAP SEPARATION**

BY: J.W. / M.HOMER  
 DATE: 02-11-09  
 OPERATIONS / DATE

CK: \_\_\_\_\_  
 ENGINEERING / DATE

SCALE: NONE  
 DIRECTOR OF ENGINEERING / DATE

REF. NOS.  
**D-5-623**

DWG. NO.  
**BK-AG**

SHEET:  
**1 OF 1**